


RevNo	Revision note	Date	Signature	Checked
-------	---------------	------	-----------	---------

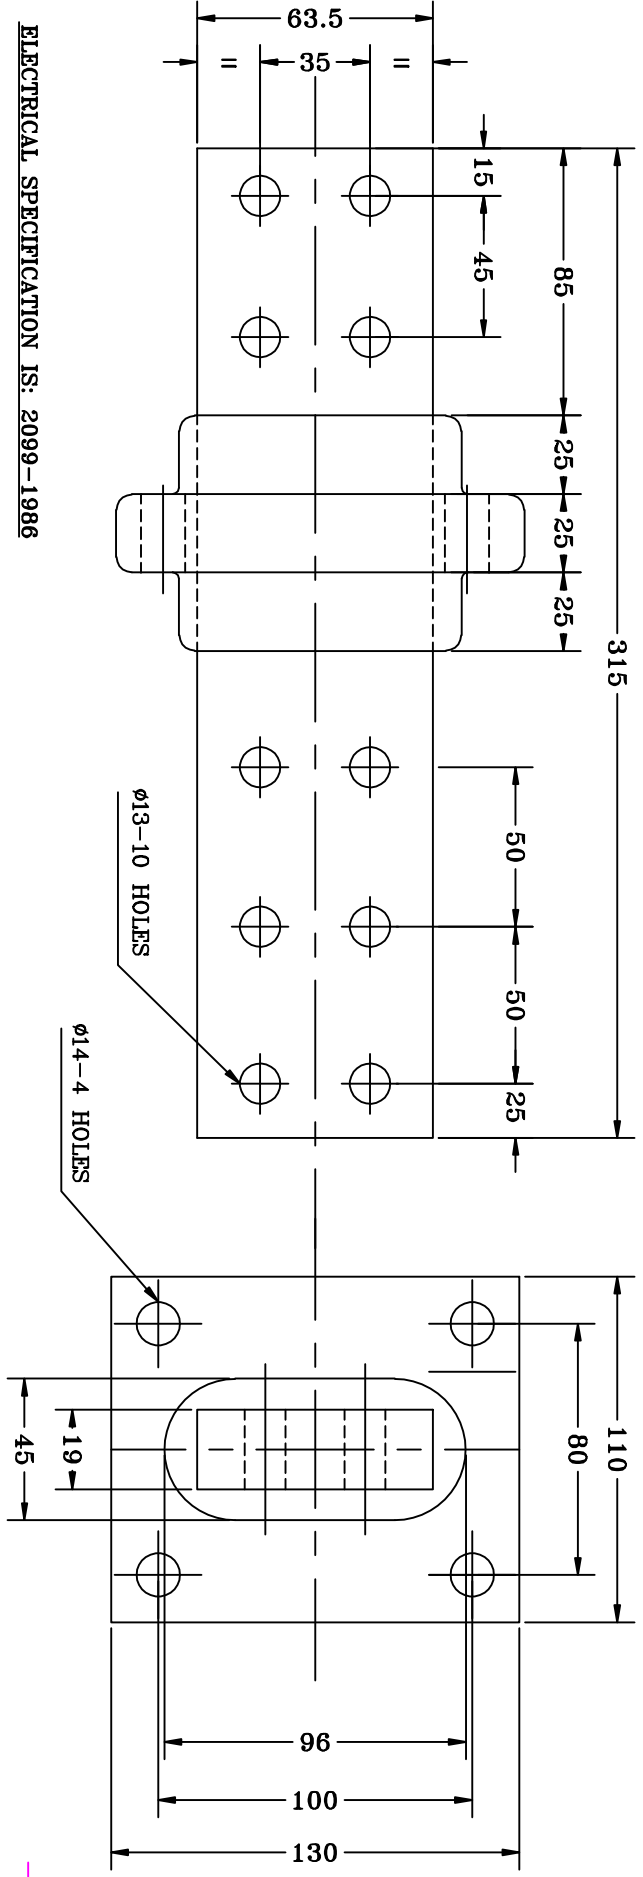

ELECTRICAL SPECIFICATION IS: 2099-1986

- 1 RATED VOLTAGE.....1.1KV
- 2 DRY POWER FREQUENCY WITHSTAND VOLTAGE TEST (ONE MINUT)...5 KV
- 3 MAXIMUM CURRENT CAPACITY.....2000 AMP.

NOTES:-

- 1 END COPPER PAIM WILL BE ELECTRONNED 12 TO 15 MICRONS.
- 2 ELECTOLYTIC COPPER WITH HIGH ELECTRICAL CONDUCTIVITY.
- 3 COLOUR BRICK RED.
- 4 ALL DIMENSION ARE IN MM.

01	1.1 kv,2000A	DISCRIPITON		TYPE	THIRD ANGLE
		EPOXY RESINE CAST BUSHING		ITEM CODE: FF0109	
		MANUFACTURER		DRAWING NO.:	
		Fibre & Fibre Glass Products		FRGP-052/11-12	
		250/7, MAGAZINE HOUSE		Sheet Edition	
		G.I.D.C. MAKARPURA,		1/1	
		VADODARA- 390010		0	
		DRN.		SIGN	
		KINJAL		DATE	
		29.04.10			
		CHD.		AP	
		APPD.		-	
		-		-	



A B C D E F