


RevNo	Revision note	Date	Signature	Checked
-------	---------------	------	-----------	---------

ELECTRICAL SPECIFICATION IS: 2099-1986

- 1 RATED VOLTAGE.....1.1KV
- 2 DRY POWER FREQUENCY WITHSTAND VOLTAGE TEST (ONE MINUT)...5 KV
- 3 MAXIMUM CURRENT CAPACITY.....4000 AMP.

NOTES:-

- 1 END COPPER PALM WILL BE ELECTRONNED 12 TO 15 MICRONS.
- 2 ELECTOLYTIC COPPER WITH HIGH ELECTRICAL CONDUCTIVITY.
- 3 COLOUR BRICK RED.
- 4 ALL DIMENSION ARE IN MM.

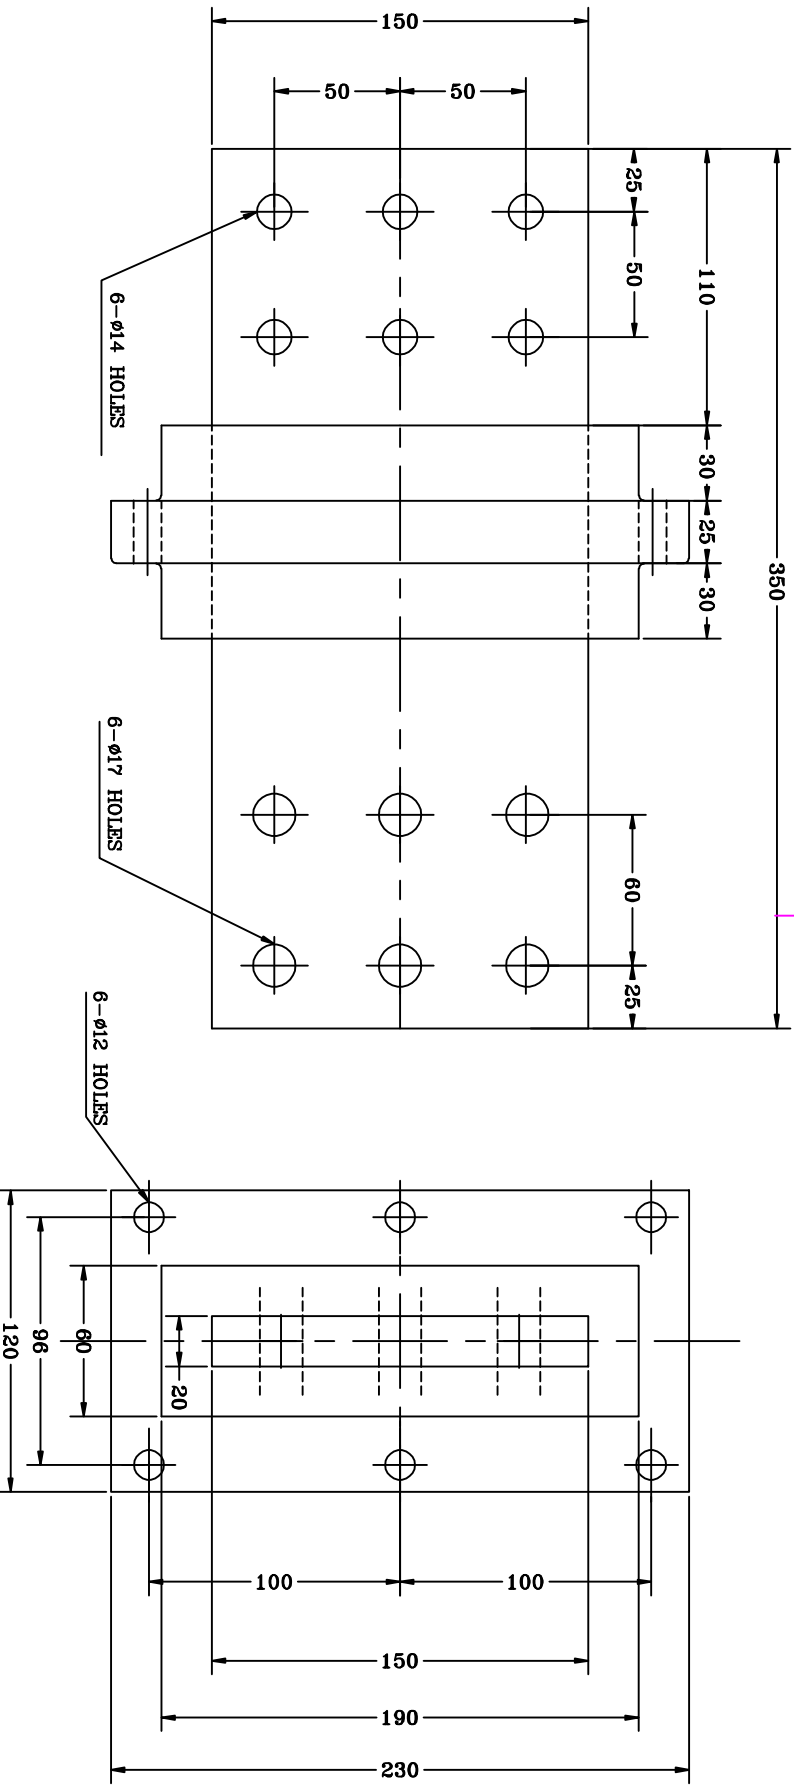

TYPE	01	1.1 kv, 4000A	DISCRIPITON
------	----	---------------	-------------

	EPOXY RESINE CAST BUSHING	ITEM CODE: PF0098	DRN.	SIGN	DATE
			CHD.	TANVT	29/10/07
			APPD.	-	-



**MANUFACTURER**  
 Fibre & Fibre Glass Products  
 250/7, MAGAZINE HOUSE  
 G.I.D.C. MAKARPURA,  
 VADODARA- 390010

**DRAWING NO.:**  
 FRGP/B-13/07-08

Sheet Edition	1/1	0	REV	0
---------------	-----	---	-----	---