



RevNo	Revision note	Date	Signature	Checked
-------	---------------	------	-----------	---------

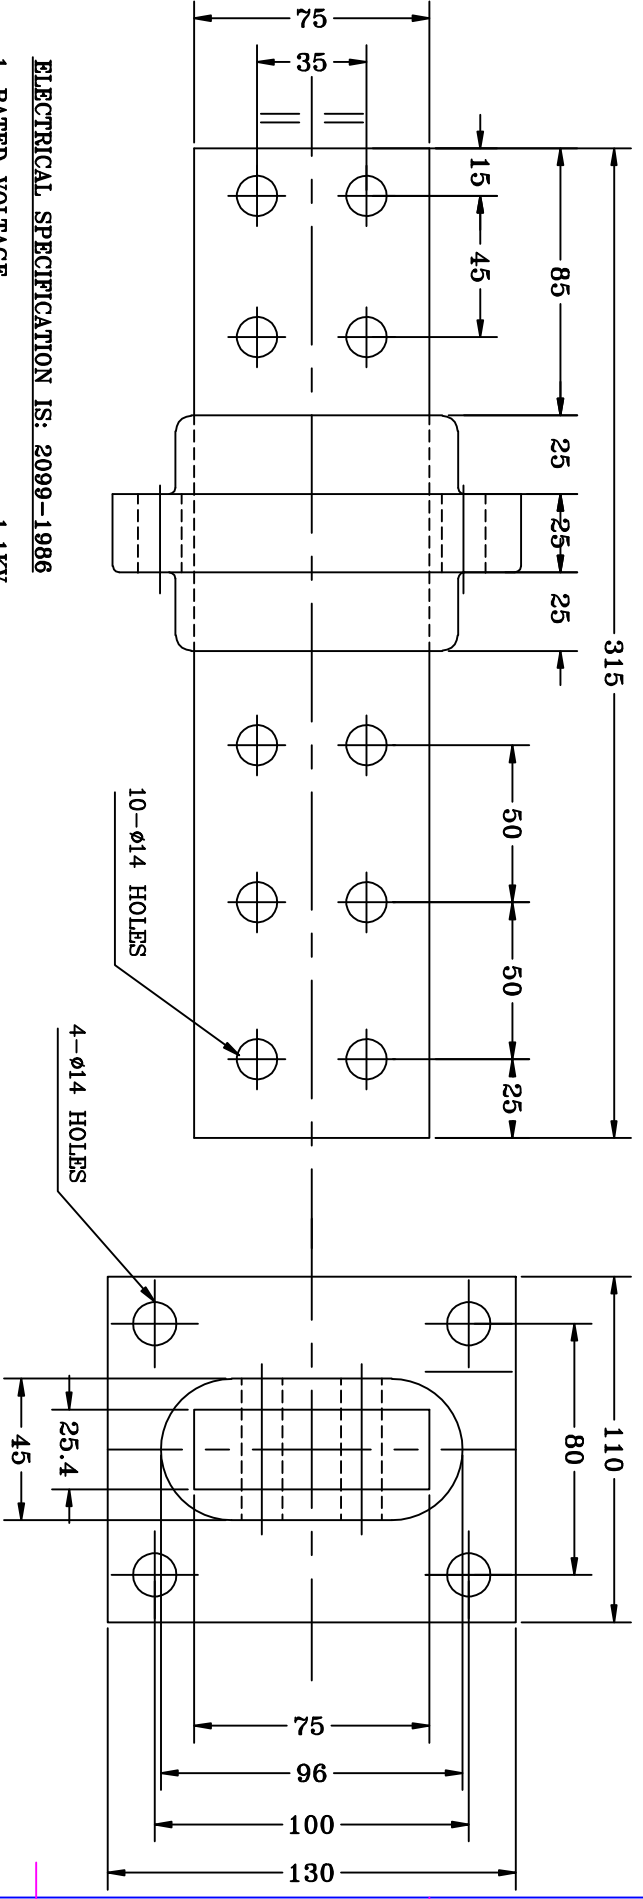

- ELECTRICAL SPECIFICATION IS: 2099-1986**
- 1 RATED VOLTAGE.....1.1KV
  - 2 DRY FLASHOVER VOLTAGE.....5 KV
  - 3 MINIMUM CURRENT CAPACITY.....3150 AMP.
- NOTES:-**
- 1 END COPPER PALM WILL BE ELECTRONNED 12 TO 15 MICRONS.
  - 2 ELECTOLYTIC COPPER WITH HIGH ELECTRICAL CONDUCTIVITY.
  - 3 COLOUR BRICK RED.
  - 4 ALL DIMENSION ARE IN MM.

01	1.1 kv,3150A	DISCRIPITON					
TYPE		EPOXY RESINE CAST BUSHING	DRN.	SIGN	DATE		
		ITEM CODE: FF0067	CHD.	TANVT	14.04.08		
			APPD.	AP	-		
		<b>MANUFACTURER</b> Fibre & Fibre Glass Products 250/7, MAGAZINE HOUSE G.I.D.C. MAKARPURA, VADODARA- 390010	<b>DRAWING NO.:</b> FRGP-014/08-09		Sheet Edition 1/1      0	REV 0	