


1	2	3	4
RevNo	Revision note	Date	Signature
			Checked

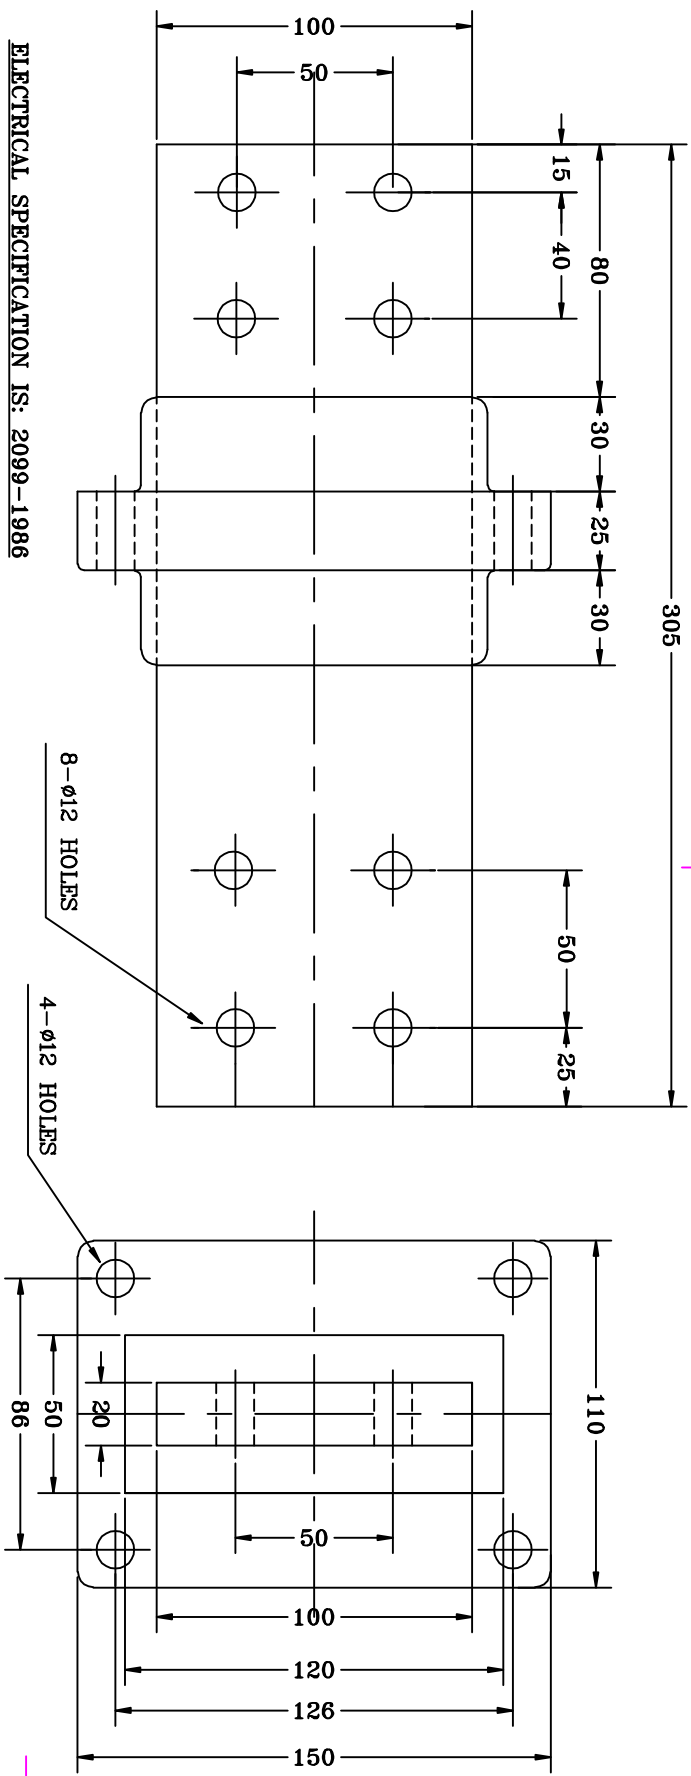

ELECTRICAL SPECIFICATION IS: 2099-1986

- 1 RATED VOLTAGE.....1.1KV
- 2 DRY FLASHOVER VOLTAGE.....5 KV
- 3 MINIMUM CURRENT CAPACITY.....3150 AMP.

NOTES:-

- 1 END COPPER PAIM WILL BE ELECTRONNED 12 TO 15 MICRONS.
- 2 ELECTOLYTIC COPPER WITH HIGH ELECTRICAL CONDUCTIVITY.
- 3 COLOUR BRICK RED.
- 4 ALL DIMENSION ARE IN MM.

01	1.1 kv, 3150AMP.	DISCRPTION		TYPE	01
		EPOXY RESINE CAST BUSHING		 THIRD ANGLE	
		ITEM CODE: FF0093		MANUFACTURER	
				Fibre & Fibre Glass Products	
				250/7, MAGAZINE HOUSE	
				G.I.D.C. MAKARPURA,	
				VADODARA - 380010	
		DRAWING NO.:		FFGP-033/08-09	
		DRN.		SIGN	
		CHD.		TANVI	
		APPD.		AP	
		DATE		05/04/08	
		REV		-	
		Sheet		Edition	
		1/1		0	
		REV		0	

A B C D E F

1 2 3 4