


RevNo	Revision note	Date	Signature	Checked
-------	---------------	------	-----------	---------

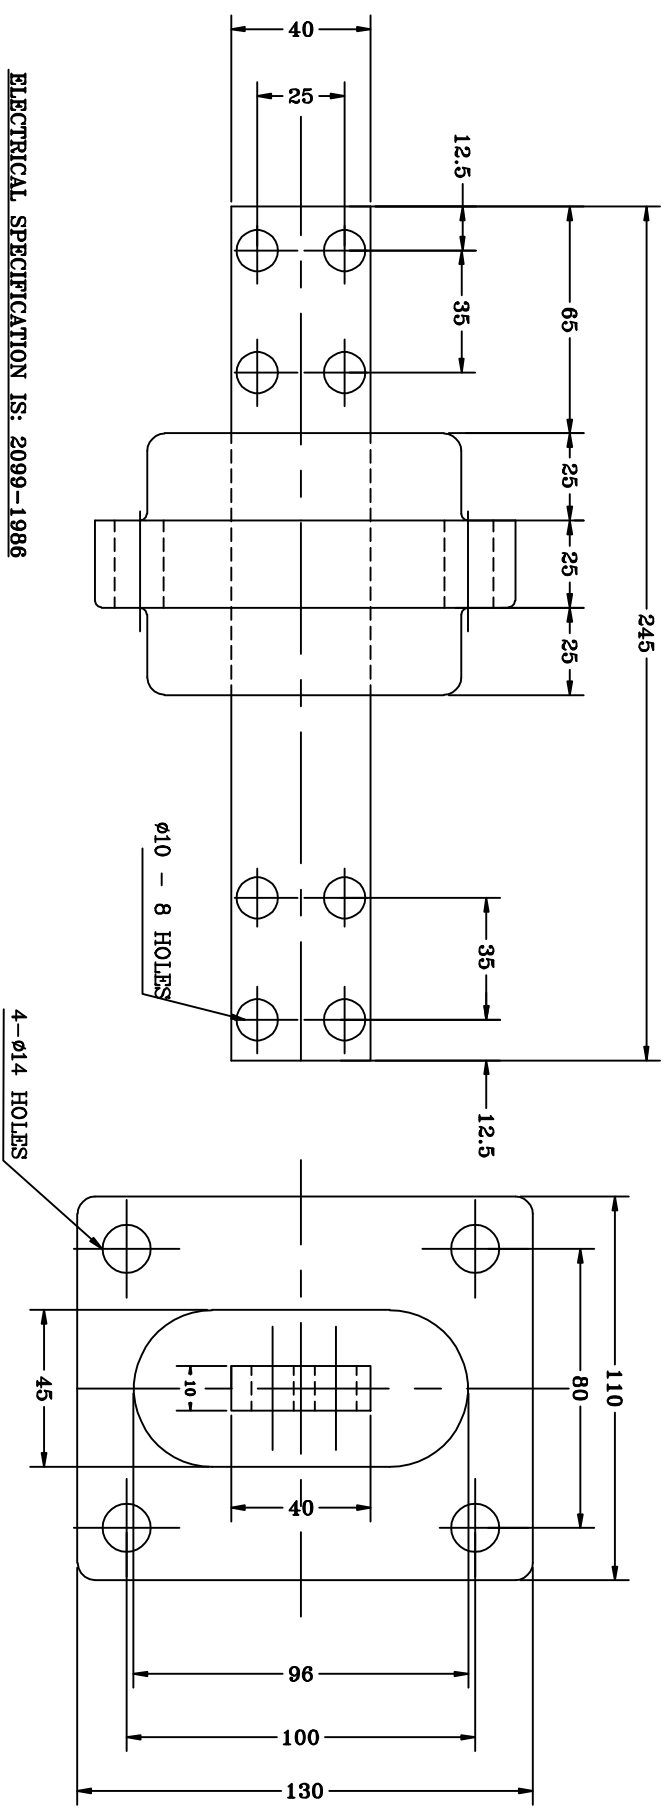

- ELECTRICAL SPECIFICATION IS: 2099-1986**
- 1 RATED VOLTAGE.....1.1kv
  - 2 DRY POWER FREQUENCY WITHSTAND VOLTAGE TEST (ONE MINUT)...5 KV
  - 3 MINIMUM CURRENT CAPACITY.....630 Amps.

- NOTES:-**
- 1 END COPPER PAIM WILL BE ELECTRONNED 12 TO 15 MICRONS.
  - 2 ELECTOLYTIC COPPER WITH HIGH ELECTRICAL CONDUCTIVITY.
  - 3 COLOUR BRICK RED.
  - 4 ALL DIMENSION ARE IN MM.

01	1.1 kv, 630A	DISCRIPYTON						
TYPE		EPOXY RESINE CAST BUSHING						
		ITEM CODE: FF0110						
			DRN.	SIGN	DATE			
			CHD.	KINJAL	29.04.2011			
			APPD.	AP	-			

**MANUFACTURER**

Fibre & Fibre Glass Products

250/7, MAGAZINE HOUSE

G.I.D.C. MAKARPURA,

VADODARA- 390010

**DRAWING NO.:**

FRGP/053/11-12

**Sheet Edition**

1/1 0

**REV**

0

A B C D E F

1 2 3 4