


Revision note	Date	Signature	Checked
---------------	------	-----------	---------

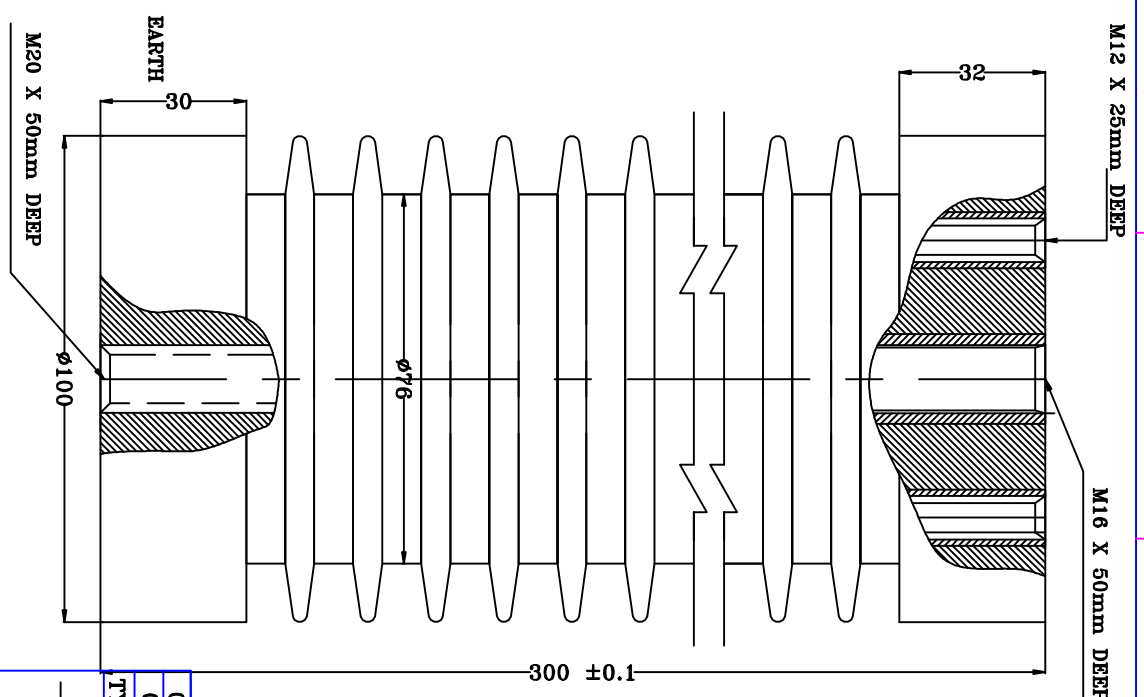

MECHANICAL SPECIFICATION IS:9431-1979

- 1 CANTILEVER FAILING LOAD F.....1350Kgs. (INHOUSE TEST)
- 2 COMPRESSION FAILING LOAD.....35000Kgs.
- 3 TENSILE FAILING LOAD.....4000Kgs.

ELECTRICAL SPECIFICATION IS:9431-1979

- 1 RATED VOLTAGE.....33kv
- 2 DRY POWER FREQ. WITHSTAND VOLTAGE TEST(ONE MINUTE).....70kv (INHOUSE TEST)
- 3 DRY LIGHTING IMPULSE WITHSTAND VOLTAGE TEST.....170kv/Peak
- 4 MINIMUM CREEPAGE DISTANCE.....590mm

OTHERS NOTES:

- 1) ALL DIMENTION ARE IN MM.
- 2) COLOURS BRICK RED

02	BRASS INSERTS
01	M.S INSERT WITH WHITE ZINK PLATING
TYPE	DISCRIPTION

<p>THIRD ANGLE</p>	33 kv	DRN.	SIGN	DATE
	EPOXY RESINE CAST INSULATOR	CHD.	TANYI	26/01/09
ITEM CODE: FF0079	APPD.	AP	-	-



MANUFACTURER
 Fibre & Fibre Glass Products
 250/7, MAGAZINE HOUSE
 G.I.D.C. MAHARAJA,
 VADODRA - 390010

DRAWING NO.:
 FFGP-021/09-10

Sheet Edition	REV
1/1	0
	1